
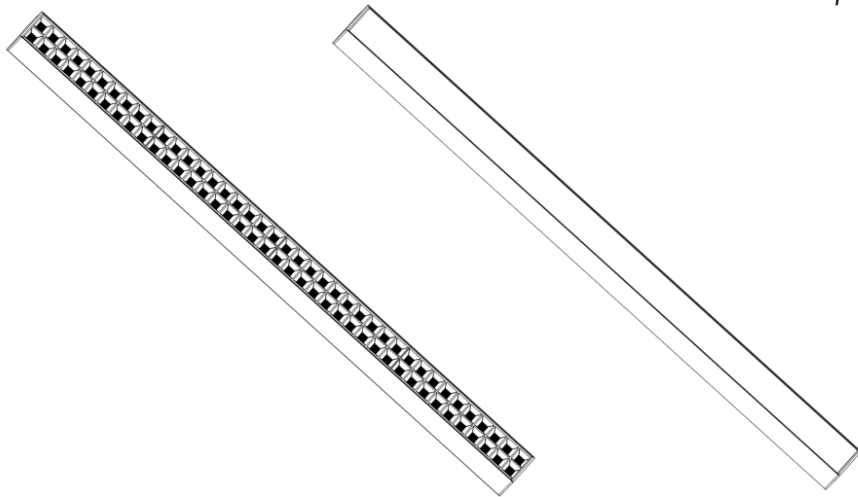


Viewline / Premline


Mounting Instructions

1. Terminal block not included. Installation must be performed by a qualified person.
2. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.
3. If the external flexible cable or cord of this luminaire is damaged, it shall be exclusively replaced by the manufacturer or his service agent or a similar qualified person in order to avoid a hazard.
4. For models with dimmable LED drivers,
 - Reinforced insulation was maintained between LV circuit and output circuit,
 - Supplementary insulation was maintained between output circuit and DALI circuits (FELV),
 - Basic insulation was maintained between LV circuit and DALI circuits (FELV).
5. Luminaires not suitable for covering with thermally insulating material.
6. The luminaire must be installed by qualified electrician in accordance with local rules and codes.


Luminaires not suitable for covering with thermally insulating material.




Cord pendant mounting (without canopy)

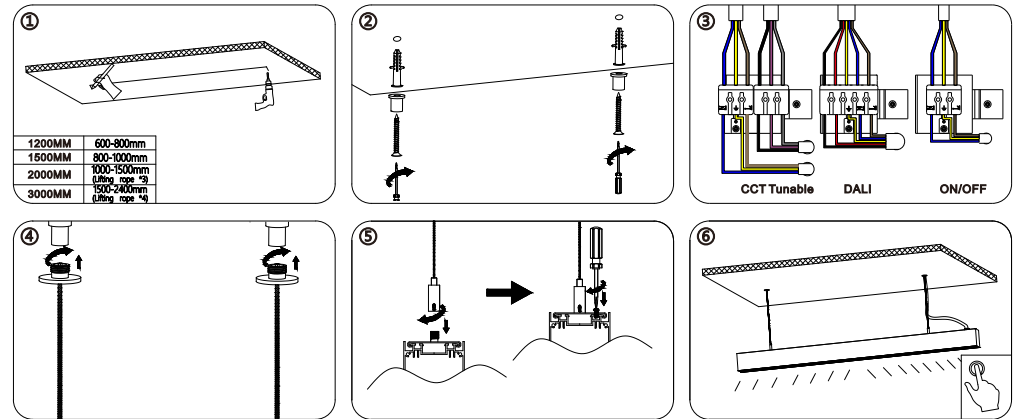


Cord pendant mounting (with canopy)

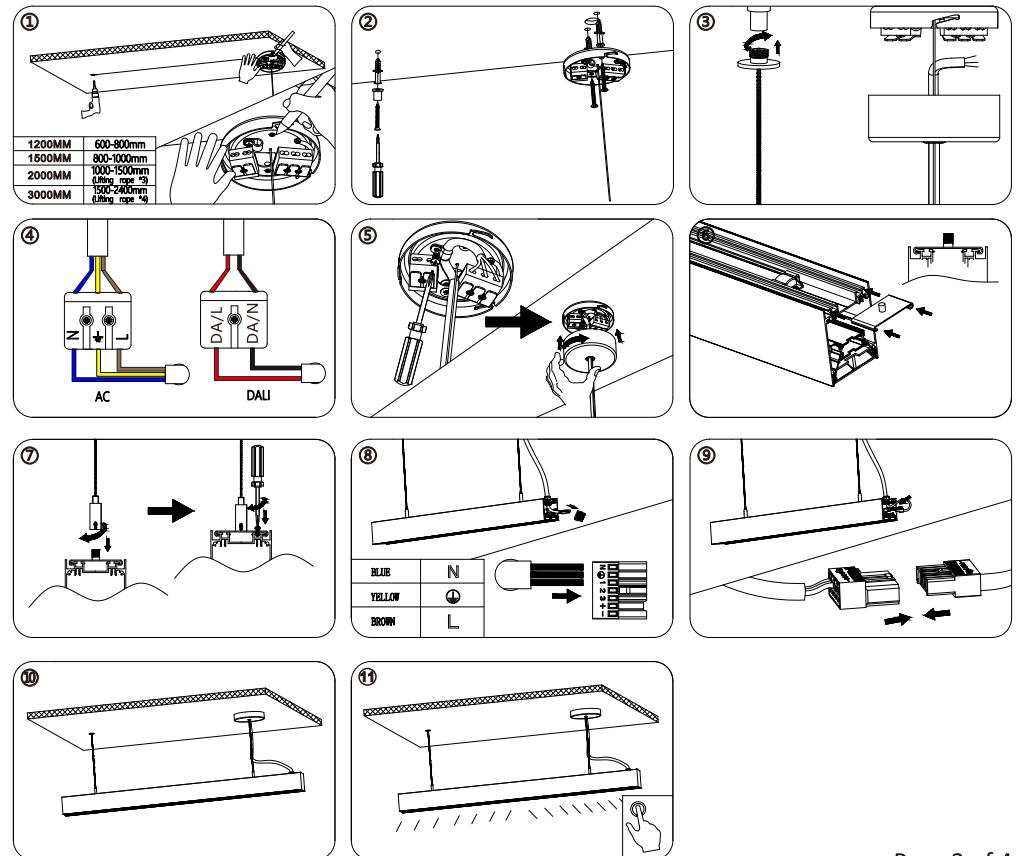


Surface mounting

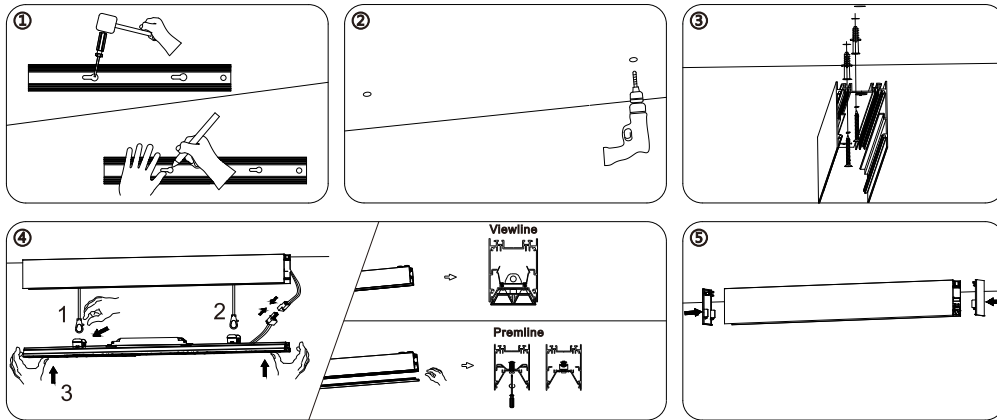


Surface mounting (with clip)

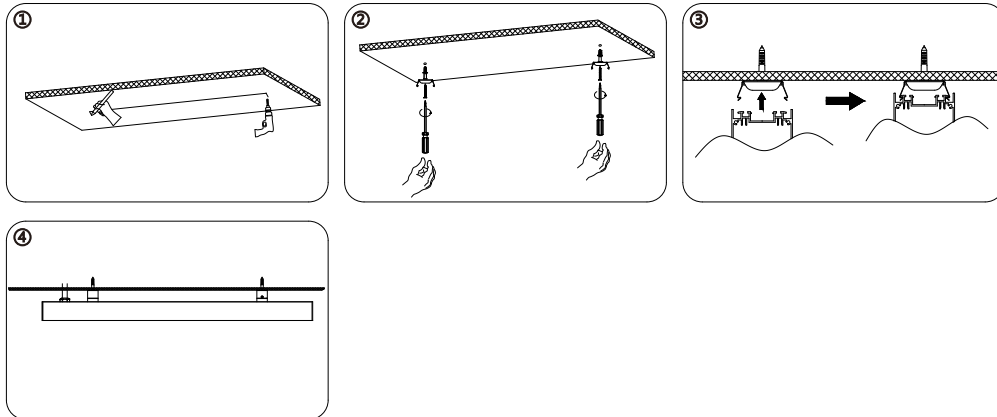


Recessed mounting

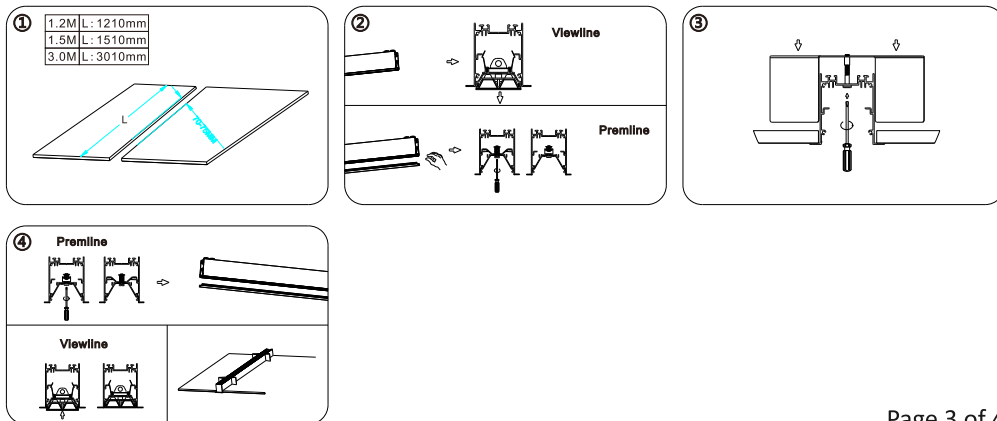


Rod pendant mounting

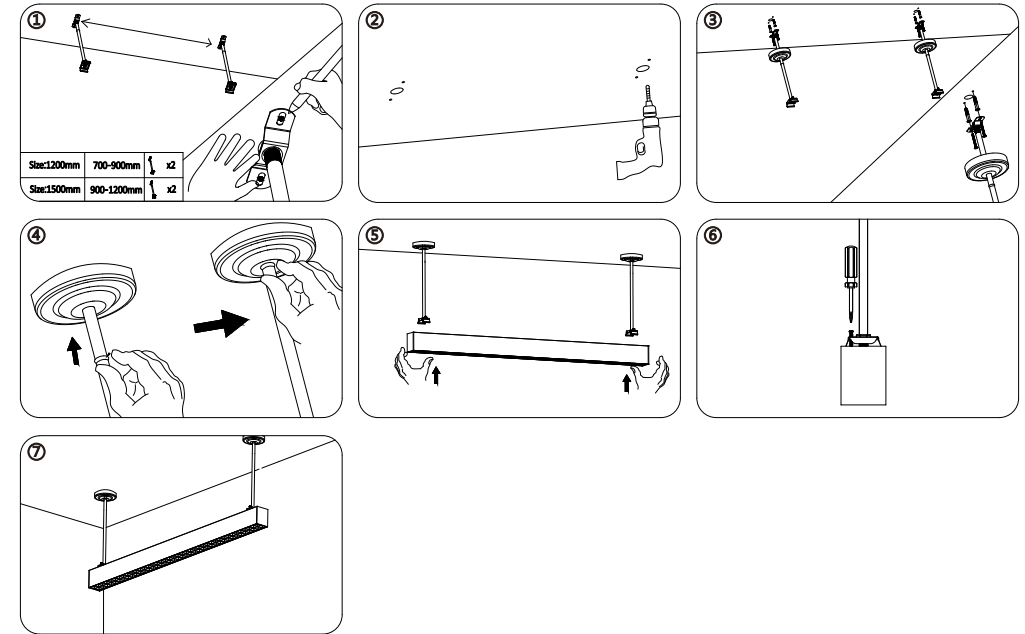

Continuous connection

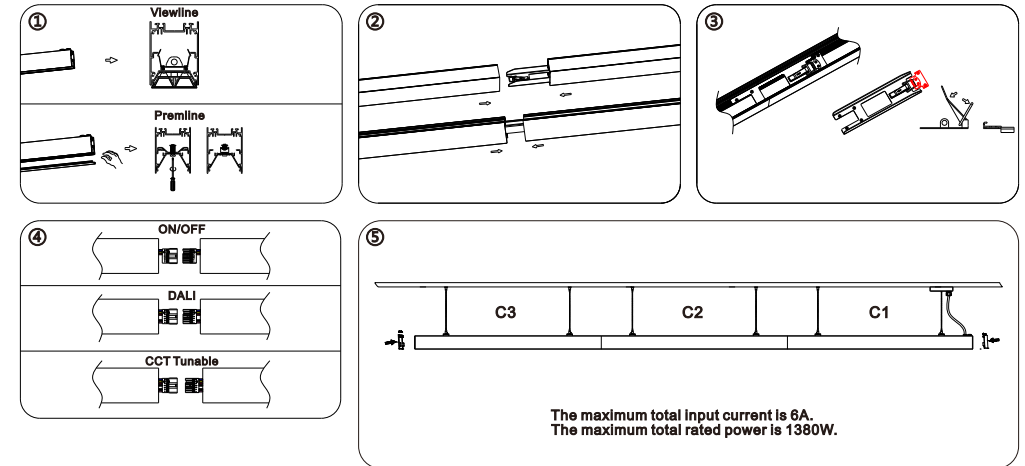

Emergency power feed wiring diagram

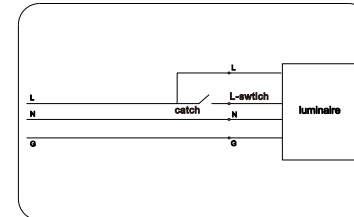

for indoor use only